



Activation SNMP sur un UPS Eaton


Le tuto a été réalisé sur un UPS Eaton 5PX 1500 Pour activer SNMP sur un UPS Eaton, rendez-vous sur l'interface web. Une fois connecté en administrateur, la page ci-dessous apparaît. Cliquez sur "Settings" en haut à droite.

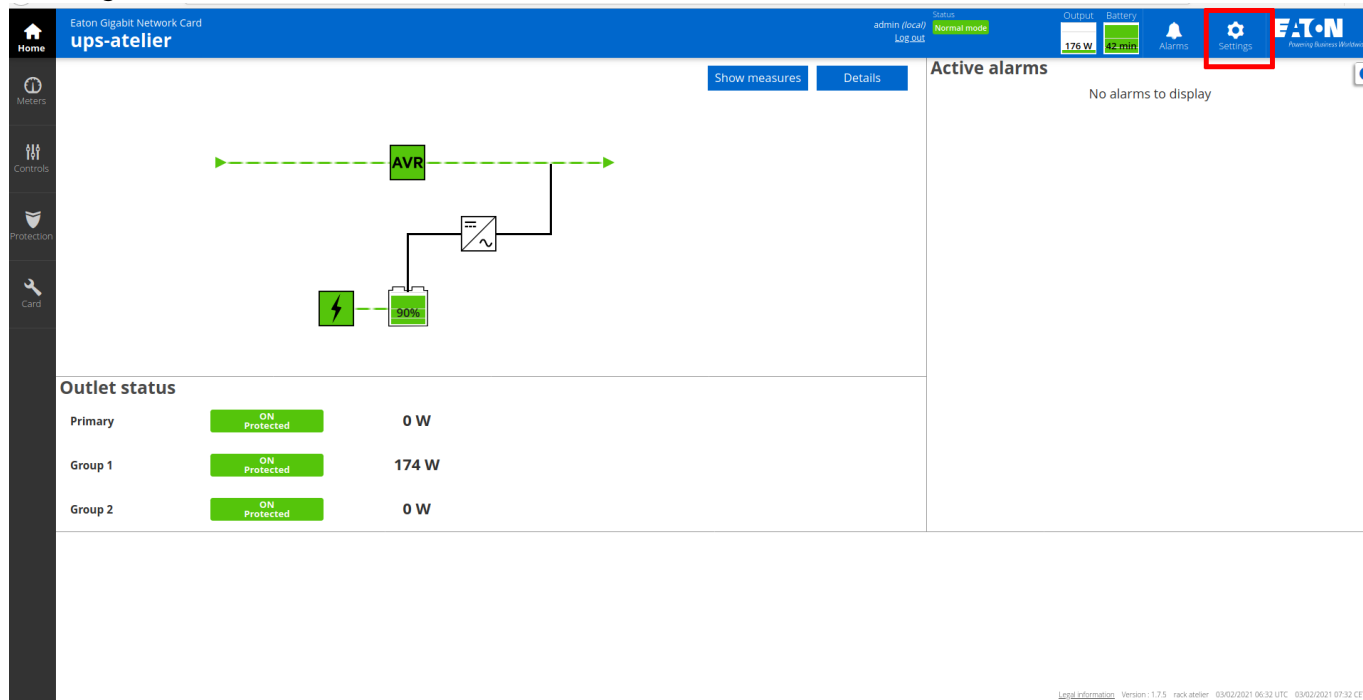


Ensuite, cliquez sur l'onglet SNMP

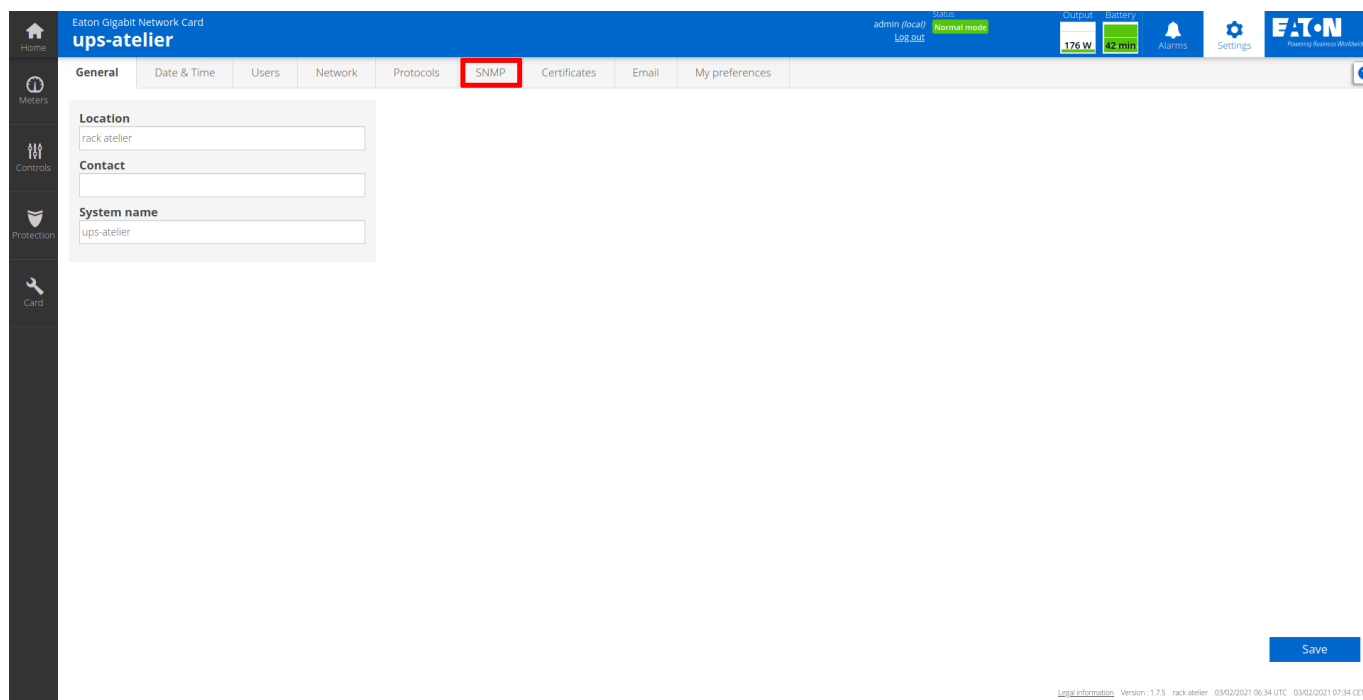

Cochez la case "Enable", "SNMP V1" et ensuite sur le petit crayon à droite de la communauté "public".

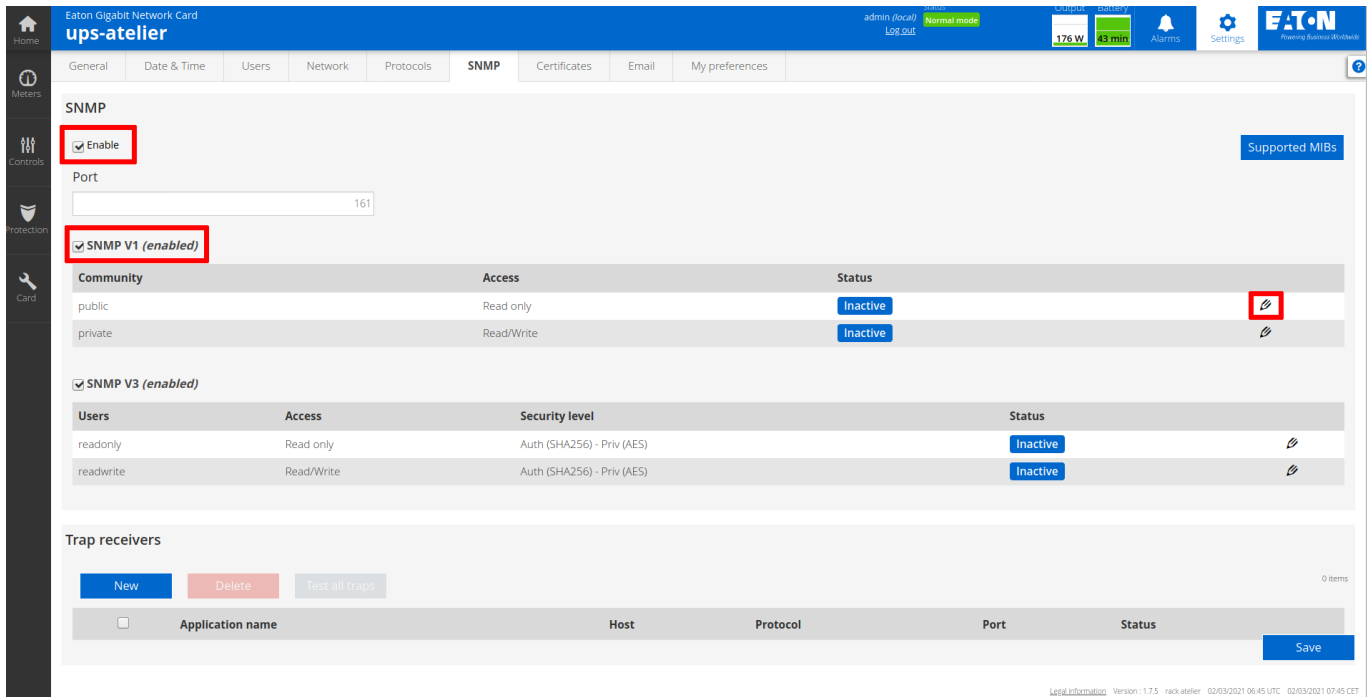

Sur l'écran qui apparaît passer le menu déroulant "Active" de "No" à "Yes" et cliquez sur "save"

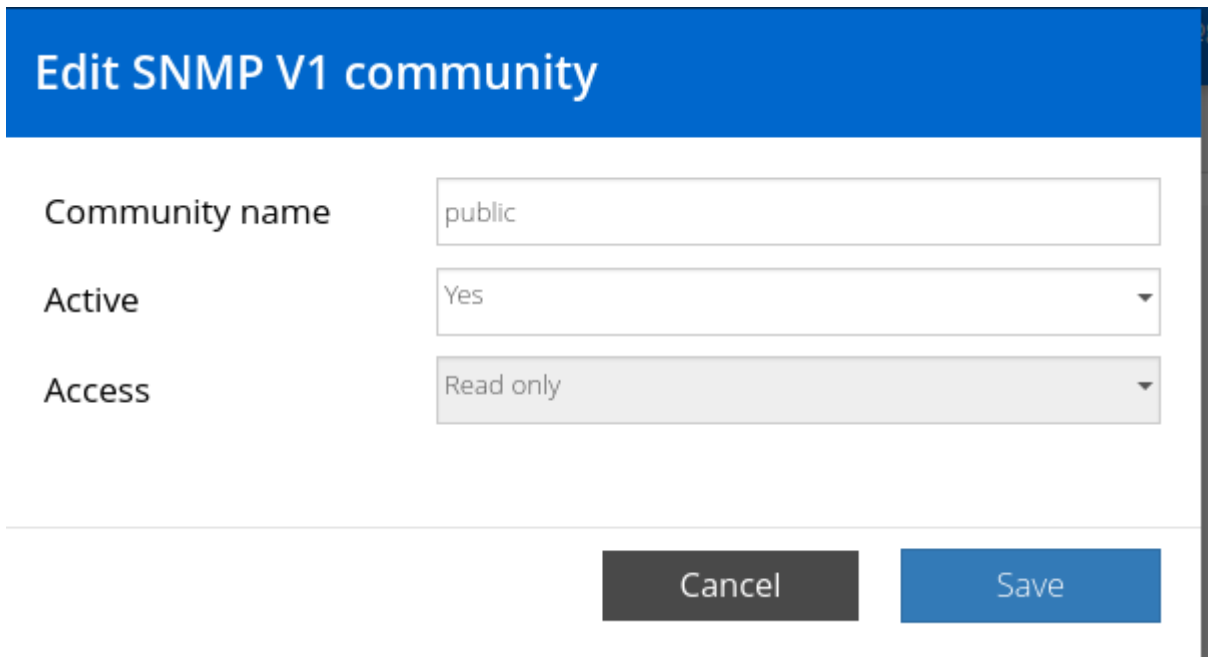

Le pop-up disparaît et la communauté passe en "Active"

Eaton Gigabit Network Card
ups-atelier

admin (local) Log out Status Normal mode Output 176 W Battery 43 min Alarm Settings Eaton

General Date & Time Users Network Protocols **SNMP** Certificates Email My preferences

SNMP

Enable Supported MIBs

Port

SNMP V1 (enabled)

Community	Access	Status	
public	Read only	Active	
private	Read/Write	Inactive	

SNMP V3 (enabled)

Users	Access	Security level	Status	
readonly	Read only	Auth (SHA256) - Priv (AES)	Inactive	
readwrite	Read/Write	Auth (SHA256) - Priv (AES)	Inactive	

Trap receivers

0 items

<input type="checkbox"/>	Application name	Host	Protocol	Port	Status	
--------------------------	------------------	------	----------	------	--------	--

Vous pouvez cliquer sur "save" (en bas à droite) pour terminer la configuration

From:
<https://wiki.esia-sa.com/> - **Esia Wiki**

Permanent link:
https://wiki.esia-sa.com/snmp/snmp_ups_eaton

Last update: **2023/02/10 10:26**

